
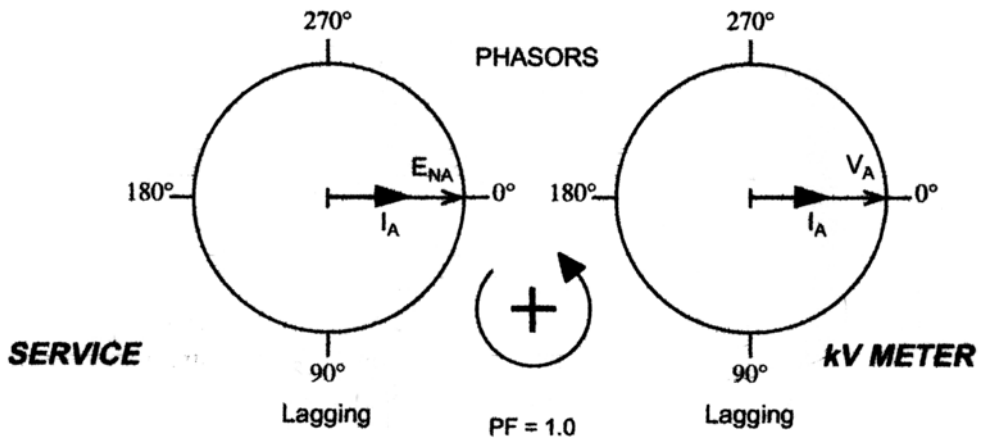
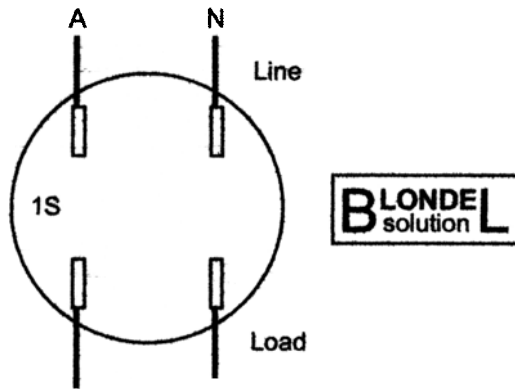


# kV Site Analysis

Form 1S (Self-Contained)



Actual installation procedures, materials, equipment, and connections must conform to applicable codes and standards

2-wire, 1-phase, 1-element

MO 3-5