

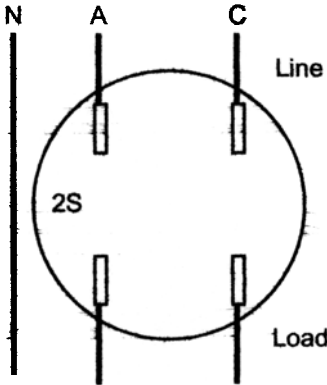


**kV Site Analysis**  
 Form 2S (Self-Contained)



*Accuracy is based on assumptions which, if not fulfilled, may result in systematic errors unrelated to meter calibration.*

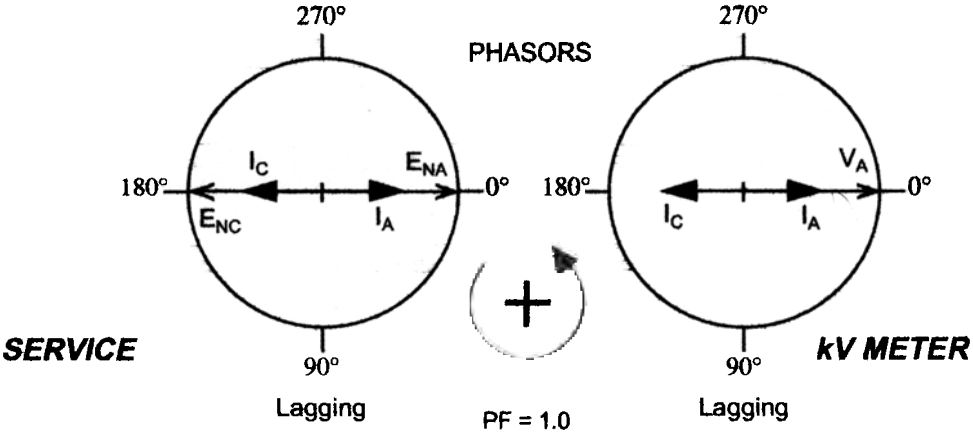

Actual installation procedures, materials, equipment, and connections must conform to applicable codes and standards

3-wire, 1-phase, 1-element

MO 2-1