
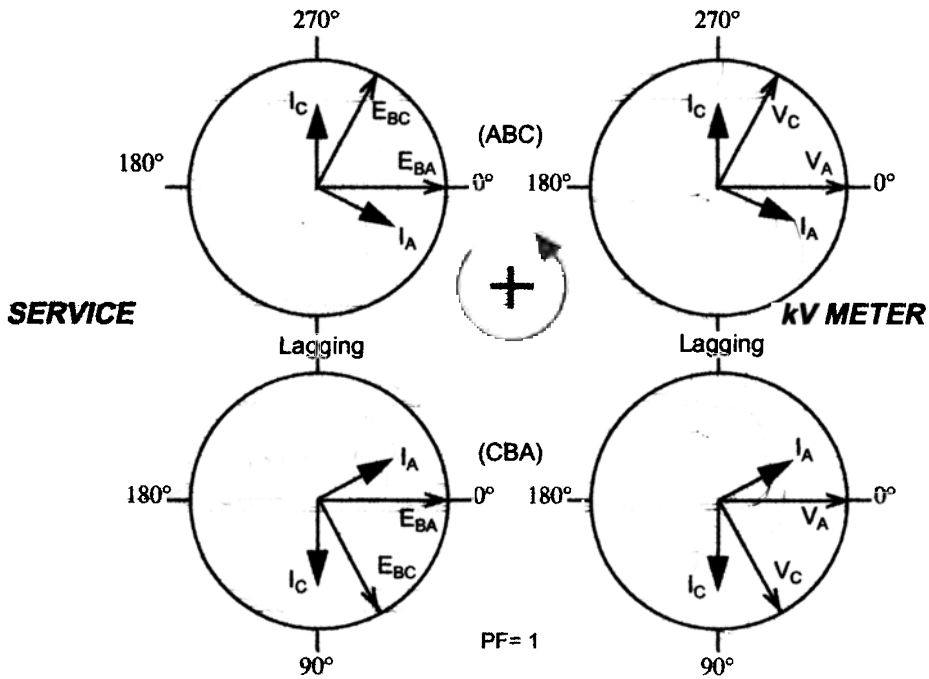
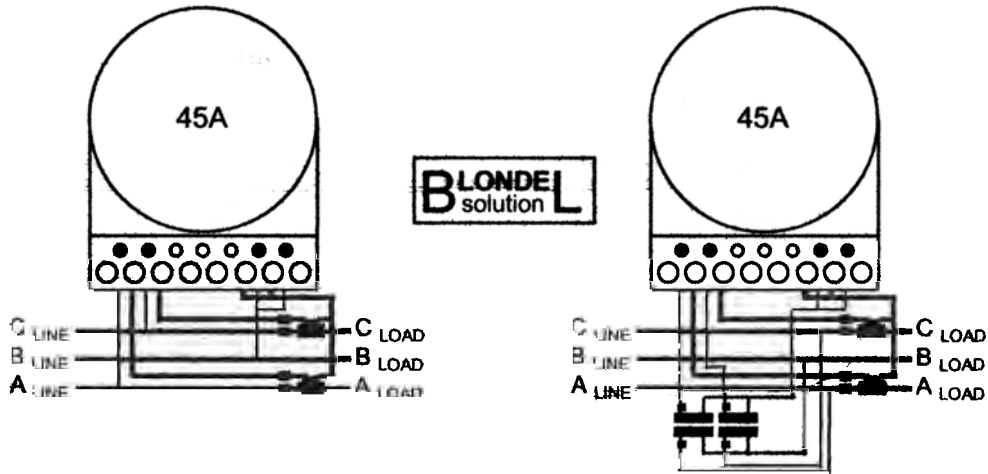


kV Site Analysis

Form 45A (Transformer Rated)



Actual installation procedures, materials, equipment, and connections must conform to applicable codes and standards

3-wire, 3-phase, 2-element

MO 45-0